Sabine River Authority

Addendum No. 1
Issued August 5, 2026

Bid Title: RFB 27-1201 Lake Tawakoni Holiday Recreation Area
Bids Due: 08/20/2026 @ 2:00 PM

Addendum #1 is issued by the Sabine River Authority. The following revisions are hereby made to the bid documents for this project.

MODIFICATIONS TO 'CONTRACT DOCUMENTS'

BIDDING REQUIREMENTS, CONTRACT DOCUMENTS AND TECHNICAL SPECIFICATIONS

REPLACE *Article 24 – Equal Opportunity* in the *Instructions to Bidders for Construction Contract* with the following:

Sabine River Authority provides for equal opportunity for all qualified parties including Veteran Owned Business. If your organization or any associated sub-contractor on the project area a certified Veteran Owned Business with the State of Texas, please submit documentation of the certified organization, including description of the work, percentage of the contract expected to be completed, and the certification number.

REPLACE the *Bid Bond (Penal Sum Form)* with the attached *Bid Bond (Penal Sum Form)*.

PLAN SHEETS

ADD sheets E1.00, E2.00, E3.00 (attached) to the end of the construction plans.

Vendors who may have already submitted a response and feel this addendum may change their response may pick up their submission and return it prior to **08/20/2026 @ 2:00 PM**. If picking up the submission is not feasible, any new response submitted by your firm will supersede one previously submitted.

All other provisions of the contract documents, plans and specifications shall remain the same. Acknowledge receipt of this addendum by initialing in the appropriate space in the Proposal Form if you have not previously submitted a response.

For questions regarding this addendum contact:
Brandon Bell, P.E.
brandon.bell@kimley-horn.com
469-301-2596

BID BOND (PENAL SUM FORM)

Bidder Name: Address *(principal place of business)*:	**Surety** Name: Address *(principal place of business)*:
Owner Name: **Sabine River Authority of Texas** Address *(principal place of business)*: **12777 Hwy 87 N** **Orange, Texas 77632**	**Bid** Project *(name and location)*: **Lake Tawakoni Holiday Recreation Area** **Wills Point, TX** Bid Due Date: **Thursday, August 20th, 2026**
Bond Penal Sum: Date of Bond:	
Surety and Bidder, intending to be legally bound hereby, subject to the terms set forth in this Bid Bond, do each cause this Bid Bond to be duly executed by an authorized officer, agent, or representative.	
Bidder	Surety
_____ *(Full formal name of Bidder)*	_____ *(Full formal name of Surety) (corporate seal)*
By: _____ *(Signature)*	By: _____ *(Signature) (Attach Power of Attorney)*
Name: _____ *(Printed or typed)*	Name: _____ *(Printed or typed)*
Title: _____	Title: _____
Attest: _____ *(Signature)*	Attest: _____ *(Signature)*
Name: _____ *(Printed or typed)*	Name: _____ *(Printed or typed)*
Title:	Title:
Notes: (1) Note: Addresses are to be used for giving any required notice. (2) Provide execution by any additional parties, such as joint venturers, if necessary.	

Copyright© 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved. Modified by SRA-TX.

1. Bidder and Surety, jointly and severally, bind themselves, their heirs, executors, administrators, successors, and assigns to pay to Owner upon default of Bidder the penal sum set forth on the face of this Bond. Payment of the penal sum is the extent of Bidder's and Surety's liability. Recovery of such penal sum under the terms of this Bond will be Owner's sole and exclusive remedy upon default of Bidder.
2. Default of Bidder occurs upon the failure of Bidder to deliver within the time required by the Bidding Documents (or any extension thereof agreed to in writing by Owner) the executed Agreement required by the Bidding Documents and any performance and payment bonds required by the Bidding Documents.
3. This obligation will be null and void if:
    3.1. Owner accepts Bidder's Bid and Bidder delivers within the time required by the Bidding Documents (or any extension thereof agreed to in writing by Owner) the executed Agreement required by the Bidding Documents and any performance and payment bonds required by the Bidding Documents, or
    3.2. All Bids are rejected by Owner, or
    3.3. Owner fails to issue a Notice of Award to Bidder within the time specified in the Bidding Documents (or any extension thereof agreed to in writing by Bidder and, if applicable, consented to by Surety when required by Paragraph 5 hereof).
4. Payment under this Bond will be due and payable upon default of Bidder and within 30 calendar days after receipt by Bidder and Surety of written notice of default from Owner, which notice will be given with reasonable promptness, identifying this Bond and the Project and including a statement of the amount due.
5. Surety waives notice of any and all defenses based on or arising out of any time extension to issue Notice of Award agreed to in writing by Owner and Bidder, provided that the total time for issuing Notice of Award including extensions does not in the aggregate exceed 120 days from the Bid due date without Surety's written consent.
6. No suit or action will be commenced under this Bond prior to 30 calendar days after the notice of default required in Paragraph 4 above is received by Bidder and Surety, and in no case later than one year after the Bid due date.
7. Any suit or action under this Bond will be commenced only in a court of competent jurisdiction located in the state in which the Project is located.
8. Notices required hereunder must be in writing and sent to Bidder and Surety at their respective addresses shown on the face of this Bond. Such notices may be sent by personal delivery, commercial courier, or by United States Postal Service registered or certified mail, return receipt requested, postage pre-paid, and will be deemed to be effective upon receipt by the party concerned.
9. Surety shall cause to be attached to this Bond a current and effective Power of Attorney evidencing the authority of the officer, agent, or representative who executed this Bond on behalf of Surety to execute, seal, and deliver such Bond and bind the Surety thereby.
10. This Bond is intended to conform to all applicable statutory requirements. Any applicable requirement of any applicable statute that has been omitted from this Bond will be deemed to be included herein as if set forth at length. If any provision of this Bond conflicts with any applicable statute, then the provision of said statute governs and the remainder of this Bond that is not in conflict therewith continues in full force and effect.
11. The term "Bid" as used herein includes a Bid, offer, or proposal as applicable.

Copyright© 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved. Modified by SRA-TX.

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc., shall be without liability to Kimley-Horn and Associates, Inc.

LUMINAIRE SCHEDULE

TYPE	DESCRIPTION	MANUFACTURER/MODEL #	VOLTAGE	WATTAGE	LAMPS	REMARKS
A	POLE MOUNTED LED AREA LUMINAIRE ON 30'-0" ROUND TAPERED STEEL POLE	AERICAN ELECTRIC *ATB2 P30I MVOLT R3 BK BL NR POLE: *RTS 30 73B B04 NDR BK ABG	208	199	LEDS FURNISHED	REFER 2/E2.00 FOR POLE BASE DETAIL

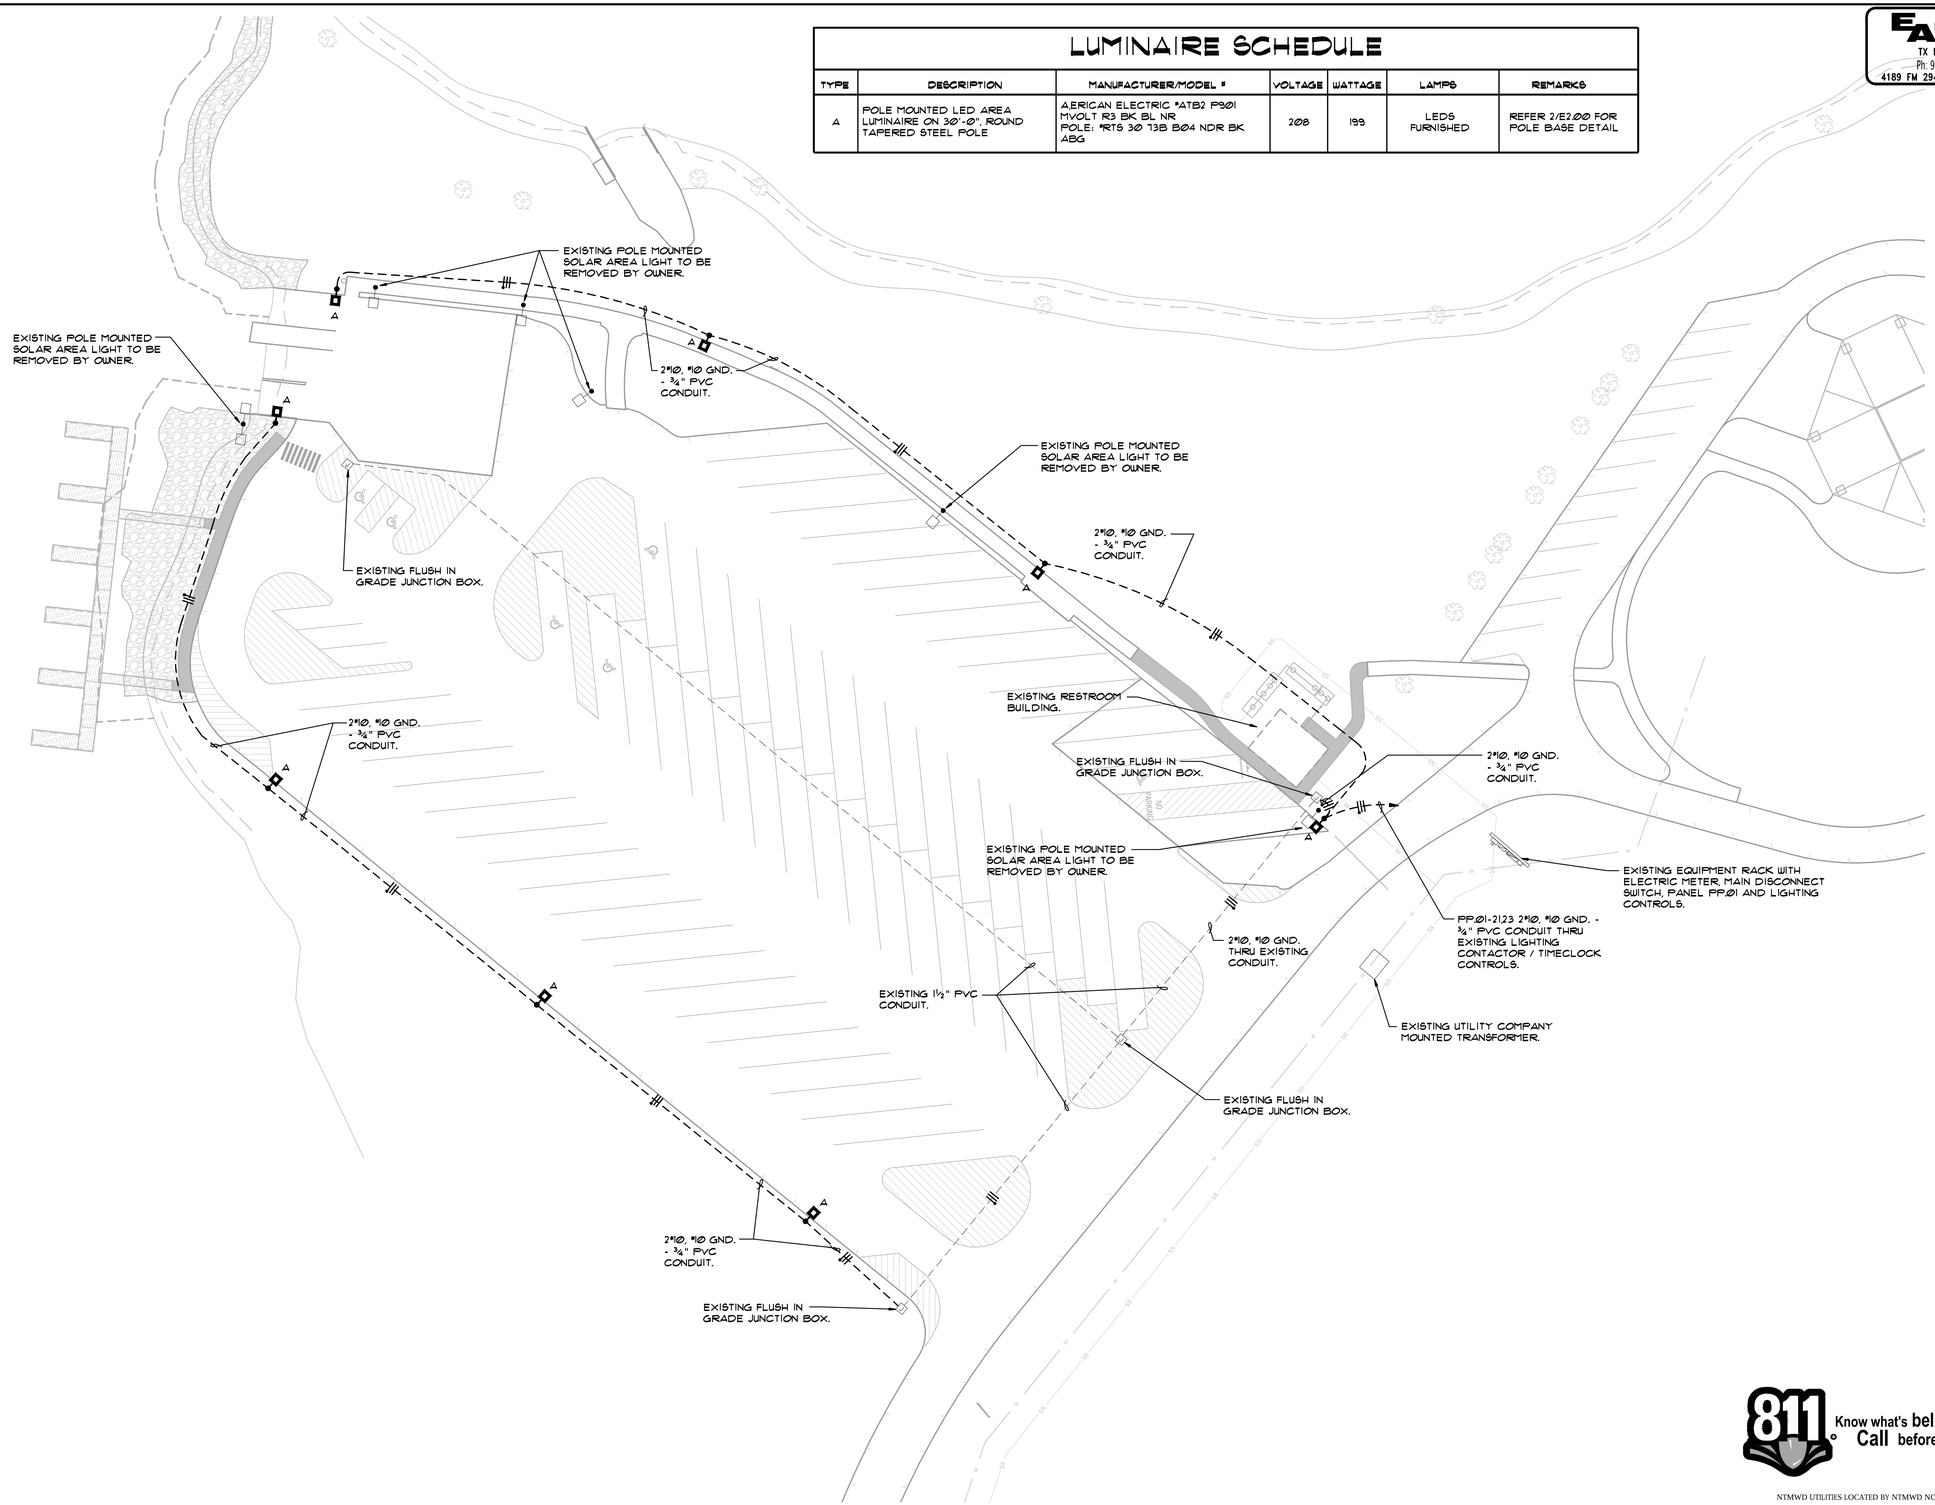

N

1 SITE PLAN - ELECTRICAL

SCALE: 1" = 30'-0"

Know what's below. Call before you dig.

NTMWD UTILITIES LOCATED BY NTMWD NOT 811

CAUTION!!

EXISTING UNDERGROUND UTILITIES IN THE AREA CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

EA ENGINEERING ASSOCIATES
TX REG #F-4925
Ph: 903 . 473 . 1977
4189 FM 2946 Emory, TX 75440

No.	REVISIONS	DATE	BY

Kimley»Horn
© 2025 KIMLEY-HORN AND ASSOCIATES, INC.
260 EAST DAVIS STREET, SUITE 100 MCKINNEY, TX 75069
PHONE: 469-301-2580
WWW.KIMLEY-HORN.COM TX F-928

JIM D. DALLAS
85922
LICENSED PROFESSIONAL ENGINEER
07/07/2026

KHA PROJECT	068925104
DATE	JULY 07, 2026
SCALE	AS SHOWN
DESIGNED BY	JW
DRAWN BY	CAD
CHECKED BY	JW

HOLIDAY REC AREA
RESTROOM UTILITY
IMPROVEMENTS
PREPARED FOR
SABINE RIVER AUTHORITY

SITE PLAN - ELECTRICAL

SHEET NUMBER
E1.00

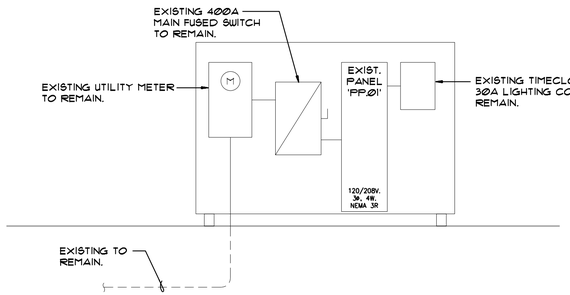

1 ELECTRICAL RISER DIAGRAM

SCALE: NONE

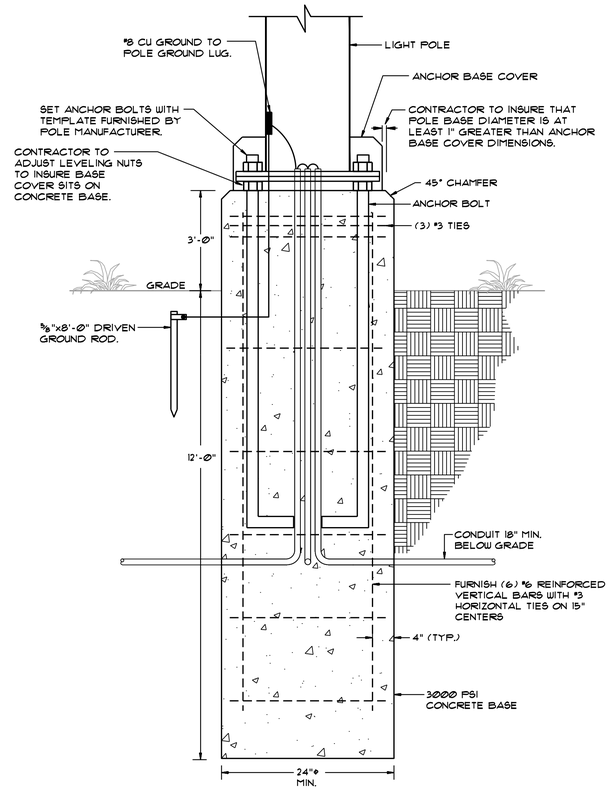

2 TYPICAL POLE BASE DETAIL

SCALE: NONE

EXISTING PANEL 'PP.01'

NOTES	DESCRIPTION	P - AMP	LOAD LIGHTING	LOAD POWER	PH / CKT #	LOAD POWER	LOAD LIGHTING	P - AMP	DESCRIPTION	NOTES
1	Spare	3	-----	-----	1 A 2	-----	-----	3	Spare	1
	↓	/	-----	-----	3 B 4	-----	-----	/	↓	
		100	-----	-----	5 C 6	-----	-----	100		
1	Spare	3	-----	-----	7 A 8	-----	-----	3	Spare	1
	↓	/	-----	-----	9 B 10	-----	-----	/	↓	
		20	-----	-----	11 C 12	-----	-----	30		
1	Spare	1 - 20	-----	-----	13 A 14	-----	-----	3	Spare	1
1	Spare	1 - 20	-----	-----	15 B 16	-----	-----	/	↓	
1	Spare	1 - 20	-----	-----	17 C 18	-----	-----	30		
1	Spare	1 - 20	-----	-----	19 A 20	-----	-----	3	Spare	1
3	Parking Lot Lighting	2	796		21 B 22	-----	-----	/	↓	
	↓	/	796		23 C 24	-----	-----	100		
1	Equalization Tank Controls	1 - 30		2400	25 A 26	-----	-----	1 - 20	Spare	1
1	Equalization Septic Pump	2		2496	27 B 28	-----	-----	1 - 20	Spare	1
	↓	/		2496	29 C 30	-----	-----	1 - 20	Spare	1
1	Aerobic System Controls	1 - 30		2400	31 A 32	-----	-----	1 - 20	Spare	1
1	Aerobic Septic Pump	2		2496	33 B 34	4740		2	Pre-Fab Restroom Panel	1
	↓	/		2496	35 C 36	4740		/	↓	
	Space Only	1 - -	-----	-----	37 A 38	6666		3	Existing Pavilion Panel	1
	Space Only	1 - -	-----	-----	39 B 40	6666		/	↓	
	Space Only	1 - -	-----	-----	41 C 42	6666		100		

LOAD SUMMARY	CONN. KW	N.E.C. DIV.	DIV. KW
LIGHTING	1.6	X 1.25	2.0
POWER	44.2	X 1.0	44.2
OTHER	0.0	X 1.0	0.0
TOTALS	45.8		46.2

POLES	42
SIZE	400 AMP
MAINS	400A/3P M.C.B.
VOLTS	120/208V., 3ø, 4W
A.I.C.	Existing
MOUNTING	Surface
ENCLOSURE	NEMA 3R
PANEL AMPS	128
LOADS PER PHASE:	
PHASE A (KW)	11.5
PHASE B (KW)	17.2
PHASE C (KW)	17.2

PROJECT	Holiday Recreation Area Lake Tawakoni, Texas
PANEL LOCATION:	Equipment Rack
DATE:	July 2026

NOTES:
1. Denotes existing circuit breaker.
2. Panel also has 150A/3P sub feed circuit breaker.
3. New circuit breaker.

811 Know what's below. Call before you dig.

NTMWD UTILITIES LOCATED BY NTMWD NOT 811

CAUTION!!
EXISTING UNDERGROUND UTILITIES IN THE AREA CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

EA ENGINEERING ASSOCIATES
TX REG #F-4925
Ph: 903 . 473 . 1977
4189 FM 2946 Emory, TX 75440

No.	REVISIONS	DATE	BY

Kimley»Horn

© 2025 KIMLEY-HORN AND ASSOCIATES, INC.

260 EAST DAVIS STREET, SUITE 100 MCKINNEY, TX 75069
PHONE: 469-301-2580
WWW.KIMLEY-HORN.COM TX F-928

JIM D. DALLAS
85922
LICENSED PROFESSIONAL ENGINEER
07/07/2026

KHA PROJECT	068925104
DATE	JULY 07, 2026
SCALE	AS SHOWN
DESIGNED BY	JW
DRAWN BY	CAD
CHECKED BY	JW

HOLIDAY REC AREA
RESTROOM UTILITY
IMPROVEMENTS
PREPARED FOR
SABINE RIVER AUTHORITY

ELECTRICAL
DETAILS

SHEET NUMBER
E2.00

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc., shall be without liability to Kimley-Horn and Associates, Inc.

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc., shall be without liability to Kimley-Horn and Associates, Inc.

DIVISION 16

ELECTRICAL SPECIFICATIONS:

A. GENERAL:

1. PROVIDE MATERIALS, LABOR, TOOLS, TRANSPORTATION, ETC. FOR COMPLETE OPERATING ELECTRICAL SYSTEMS FOR LIGHTING, POWER AND CONTROL AS DESCRIBED HEREIN AND ILLUSTRATED ON THE DRAWINGS.
2. EXISTING EQUIPMENT, OUTLETS, AND/OR LIGHTING FIXTURES WHICH ARE TO BE REMOVED SHALL BE DISCONNECTED FROM THEIR SOURCE OF SUPPLY. BRANCH CIRCUIT, FEEDER AND CONTROL WIRING SHALL BE REMOVED BACK TO THE SOURCE OF SUPPLY AND CONDUIT OR RACEWAY SHALL BE REMOVED BACK TO A POINT WHICH WILL NOT BE EXPOSED TO VIEW FROM FINISHED SPACES.
3. EXISTING OUTLETS WHICH ARE TO REMAIN ACTIVE AND HAVE HAD THEIR CIRCUIT INTERRUPTED DUE TO REMOVAL OR DEMOLITION SHALL BE RECONNECTED TO THE SOURCE OF SUPPLY WITH EQUAL CAPACITY CONDUCTORS IN METAL CONDUIT IN EXPOSED AREAS, AND PVC CONDUIT IN UNDERGROUND INSTALLATIONS.
4. FIXTURES AND EQUIPMENT WHICH ARE INDICATED TO BE REMOVED OR WHICH ARE NOT REQUIRED FOR REUSE SHALL HAVE WIRING REMOVED BACK TO THE SOURCE OF SUPPLY.
5. EXISTING LIGHTING BRANCH CIRCUITS MAY BE EXTENDED AND REUSED TO SERVE NEW LIGHTING CIRCUITS. WHERE EXISTING LIGHTING CIRCUITS ARE INOPERATIVE OR FOUND TO BE IN POOR REPAIR, THEY SHALL BE REPLACED WITH THE CIRCUITS ILLUSTRATED ON THE DRAWINGS.

B. SCOPE OF WORK:

1. WORK INCLUDED: PROVIDE COMPLETE ELECTRICAL WORK WHERE SHOWN ON DRAWINGS, AS SPECIFIED HEREIN, AND AS NEEDED FOR A COMPLETE AND PROPER INSTALLATION INCLUDING, BUT NOT NECESSARILY LIMITED TO THE FOLLOWING SUMMARY OF WORK:
   a. CIRCUIT BREAKERS.
   b. LED LIGHT POLES AND FIXTURES.
   c. BRANCH CIRCUIT WIRING.
   d. OTHER ITEMS AND SERVICES REQUIRED TO COMPLETE THE SYSTEMS.

C. CODE COMPLIANCE:

1. ELECTRICAL WORK TO CONFORM WITH THE 2017 EDITION OF THE NATIONAL ELECTRICAL CODE (N.E.C.) AND APPLICABLE LOCAL ORDINANCES.

D. RACEWAYS:

1. RACEWAYS SHALL BE SIZED AS INDICATED ON THE DRAWINGS AND AS REQUIRED BY THE N.E.C. TO PREVENT DAMAGE TO THE CONDUCTORS. DO NOT USE RACEWAYS SIZED LESS THAN 3/4" UNLESS SPECIFIED OTHERWISE.
2. PROVIDE GALVANIZED RIGID METAL RACEWAY FOR ALL USES IN DAMP AND WET LOCATIONS, IN HAZARDOUS AREAS AND IN LOCATIONS SUBJECT TO PHYSICAL DAMAGE.
3. ALL CONDUIT ENTERING BOXES SHALL BE SECURED WITH INSULATING THROAT CONNECTORS AND LOCKNUTS.
4. PROVIDE LIQUIDTIGHT FLEXIBLE CONDUIT CONNECTION FOR FINAL CONNECTION TO EACH MOTOR, NOT TO EXCEED 36 INCHES IN LENGTH.
5. ALL EXPOSED RACEWAYS SHALL BE INSTALLED WITH RUNS PARALLEL AND/OR PERPENDICULAR WITH STRUCTURAL MEMBERS AND WALLS.
6. PROVIDE FIRE SEALING MATERIALS FOR ALL RACEWAYS PASSING THROUGH FIRE RATED PARTITIONS, WALLS AND FLOORS.

E. HANGERS AND SUPPORTS:

1. USE CAST "C" CLAMPS, "U" STRAPS OR RING HANGERS ATTACHED TO RODS, AND/OR BRACKETS FASTENED TO STRUCTURE FOR INDIVIDUAL CONDUITS.
2. SUPPORT GROUPED RACEWAYS TOGETHER IN HORIZONTAL RUNS ON TRAPEZE HANGERS CONSTRUCTED OF UNISTRUT OR EQUAL SUSPENDED FROM CAD-PLATED STEEL RODS.

F. WIRE AND CABLES:

1. ELECTRICAL CONDUCTORS SHALL BE OF SOFT DRAWN COPPER WITH CONDUCTIVITY 98% OF PURE COPPER, EQUAL TO GENERAL CABLE COMPANY.
2. ELECTRICAL CONDUCTORS SHALL BE SOLID FOR #10 AND SMALLER, STRANDED FOR #8 AND LARGER.
3. WIRE AND CABLE FOR ALL BRANCH CIRCUITS, FEEDERS, SUB-FEEDERS, MOTOR CIRCUITS AND HIGH AMBIENT LOCATIONS SHALL BE TYPE THWN/THHN.
4. ALL LIGHTING AND POWER CIRCUITS SHALL BE #12 OR LARGER.
5. FOR 120V CIRCUITS: HOME RUNS OVER 100' LONG, USE #10 CONDUCTORS.
6. FOR 120V CIRCUITS: HOME RUNS OVER 200' LONG, USE #8 CONDUCTORS.
7. CONSISTENTLY COLOR CODE WIRING CONTINUOUS THROUGHOUT THE WORK:
   a. 120/208 VOLT SYSTEMS:
      1. PHASE A - RED.
      2. PHASE B - BLACK.
      3. PHASE C - BLUE.
      4. NEUTRAL - WHITE.
      5. GROUND - GREEN.
8. BRANCH CIRCUIT WIRING MAY BE COMBINED INTO A SINGLE RACEWAY IN ACCORDANCE WITH NOTE 8 TO TABLES 310-16 THROUGH 310-31 OF THE N.E.C., UNLESS OTHERWISE NOTED.
9. FEEDER WIRING SHALL NOT BE COMBINED INTO A SINGLE RACEWAY.

G. SPLICES AND TAPS:

1. STRANDED CONDUCTORS, #8 OR LARGER, SHALL BE SPLICED AND TAPPED WITH CAST COPPER SOLDERLESS PRESSURE CONNECTORS WITH MOLDED PHENOLIC INSULATING COVERS, O.Z. TYPE XTP OR PH, OR INSULATED WITH RUBBER END FRICTION TAPE.
2. SOLID CONDUCTORS, #10 AND SMALLER, SHALL BE SPLICED WITH INSULATED SPRING CONNECTORS, IDEAL OR 3M COMPANY.

H. GROUNDING:

1. GROUND ALL ELECTRICAL APPARATUS IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE.
2. PROVIDE TWO-HOLE, PAD TYPE COMPRESSION CONNECTORS, T&B COLOR-KEYED TYPE OR BURNDY.
3. ENSURE CONTINUOUS BOND WHERE FLEXIBLE CONDUIT IS USED.

I. OUTLET BOXES:

1. GENERAL ELECTRIC, APPLETON, STEEL CITY OR RACO HOT DIPPED GALVANIZED STEEL BOXES, OR EQUAL, UNLESS SPECIFIED OTHERWISE.
2. PROVIDE SIZE, TYPE, DESIGN, TO SUIT STRUCTURAL CONDITIONS.
3. ADEQUATE TO ACCOMMODATE SIZE AND NUMBER OF RACEWAYS, CONDUCTORS, AND DEVICE OR FIXTURE SERVED BY IT.
4. PROVIDE PLASTER RINGS AND/OR COVERS ON BOXES WHERE REQUIRED.
5. ON EXPOSED WORK, PROVIDE APPROVED CAST FERROUS ALLOY OUTLET, JUNCTION BOXES AND FITTINGS.
6. FIXTURE OR DEVICE COVER SHALL COMPLETELY CONCEAL THE TYPE OUTLET BOX USED.
7. RECEPTACLES SHALL BE MOUNTED 18 INCHES ABOVE FINISHED GRADE, UNLESS OTHERWISE NOTED.

J. PULL AND JUNCTION BOXES:

1. SHEET METAL BOXES: ANSI/NEMA OS 1; GALVANIZED STEEL.
2. SHEET METAL BOXES LARGER THAN 12 INCHES IN ANY DIMENSION SHALL HAVE A HINGED ENCLOSURE.
3. CONCRETE BOXES FOR IN-GROUND INSTALLATIONS: TYPE 4, OUTSIDE FLANGED, RECESSED COVER BOX FOR FLUSH MOUNTING, PLAIN COVER WITH NEOPRENE GASKET AND STAINLESS STEEL COVER SCREWS.
4. LOCATE PULL BOXES AND JUNCTION BOXES ABOVE ACCESSIBLE CEILINGS OR IN UNFINISHED AREAS.
5. SUPPORT PULL AND JUNCTION BOXES INDEPENDENT OF CONDUIT.
6. SET IN-GROUND PULL AND JUNCTION BOXES LEVEL AND FLUSH WITH FINISHED GRADE.
7. PROVIDE COVERPLATES FOR ALL JUNCTION BOXES.
8. INDICATE ON COVERPLATES, WITH PERMANENT MARKER, CIRCUITS CONTAINED WITHIN JUNCTION BOXES.

K. NAMEPLATES:

1. DISTRIBUTION AND BRANCH CIRCUIT PANELBOARDS: PROVIDE ENGRAVED, LAMACOID PLASTIC NAMEPLATE SHOWING PANELBOARD DESIGNATION AND SOURCE (CIRCUIT DESIGNATION) OF POWER.
2. DISCONNECT SWITCHES: PROVIDE ENGRAVED, LAMACOID PLASTIC NAMEPLATE SHOWING EQUIPMENT DESIGNATION AND SOURCE (CIRCUIT DESIGNATION) OF POWER. PROVIDE NEW NAMEPLATES FOR EQUIPMENT BEING REFED.
3. DISTRIBUTION AND BRANCH CIRCUIT PANELBOARDS: PROVIDE NEATLY TYPEWRITTEN CIRCUIT DIRECTORY IN CARDHOLDER INSIDE PANELBOARD DOOR.

L. SUBMITTALS:

1. PRODUCT DATA: SUBMIT THE FOLLOWING:
   a. MATERIALS LIST OF ITEMS PROPOSED TO BE PROVIDED UNDER DIVISION 16.
   b. MANUFACTURER'S SPECIFICATIONS AND OTHER DATA NEEDED TO PROVE COMPLIANCE WITH THE SPECIFIED ITEMS.
2. SUBMITTALS REQUIRED OF MATERIALS AND EQUIPMENT UNDER THIS SECTION INCLUDE THE FOLLOWING:
   a. CIRCUIT BREAKERS.
   b. LIGHT POLES AND FIXTURES.
   c. CONDUCTORS.
   d. CONDUIT AND FITTINGS.
   e. CABINETS.
   f. GROUNDING AND BONDING SYSTEM.

M. SUBSTITUTIONS:

1. SUBMITTALS FOR "EQUAL" ITEMS SHALL, WHERE APPLICABLE, INCLUDE THE FOLLOWING DATA WHICH ARE NOT NECESSARILY REQUIRED FOR SPECIFIED ITEMS:
   a. PERFORMANCE CHARACTERISTICS
   b. MATERIALS
   c. FINISH
   d. CERTIFICATION OF CONFORMANCE WITH SPECIFIED CODES AND STANDARDS.
2. SUBMITTALS OF "EQUAL" COMPONENTS OR SYSTEMS MAY BE REJECTED IF:
   a. THE MATERIALS OR EQUIPMENT WOULD NECESSITATE THE ALTERATION OF ANY PORTION OF THE MECHANICAL, ELECTRICAL, ARCHITECTURAL OR STRUCTURAL DESIGN.
   b. DIMENSIONS VARY FROM THE SPECIFIED MATERIAL OR EQUIPMENT IN SUCH A MANNER THAT THE ACCESSIBILITY OR CLEARANCES ARE IMPAIRED OR THE WORK OF OTHER TRADES IS ADVERSELY AFFECTED.
3. PROPOSED SUBSTITUTIONS FOR MATERIALS OR EQUIPMENT MUST BE SUBMITTED TEN (10) DAYS PRIOR TO FINAL BID DATE FOR CONSIDERATION AS APPROVED EQUALS. OTHERWISE, SUCH SUBSTITUTIONS WILL NOT BE PERMITTED. PROPOSALS FOR SUBSTITUTIONS SHALL BE MADE ONLY BY THE BIDDERS, MANUFACTURERS, DISTRIBUTORS AND SUBCONTRACTORS SHALL NOT MAKE PROPOSALS TO THE OWNER FOR SUBSTITUTIONS.
4. NO SUBSTITUTIONS SHALL BE MADE UNLESS AUTHORIZED IN WRITING BY THE OWNER, SHOULD A SUBSTITUTION BE ACCEPTED, AND SHOULD THE SUBSTITUTE MATERIAL PROVE DEFECTIVE OR OTHERWISE UNSATISFACTORY FOR THE SERVICE INTENDED, AND WITHIN THE GUARANTEE PERIOD, THE CONTRACTOR SHALL REPLACE THIS MATERIAL OR EQUIPMENT WITH MATERIAL OR EQUIPMENT SPECIFIED, AT HIS OWN EXPENSE, AND TO THE SATISFACTION OF THE OWNER.

N. GUARANTEE:

1. GUARANTEE ENTIRE INSTALLATION TO BE IN GOOD REPAIR AND PROPER WORKING ORDER FOR A PERIOD OF ONE-YEAR FOLLOWING DATE OF FINAL ACCEPTANCE.

O. CLOSE OUT DOCUMENTS

1. PROVIDE OWNER WITH AS-BUILTS DRAWINGS, MANUFACTURER'S WARRANTIES AT FINAL ACCEPTANCE OF INSTALLATION.

END OF SPECIFICATION

811 Know what's below. Call before you dig.

NTMWD UTILITIES LOCATED BY NTMWD NOT 811

CAUTION!!
EXISTING UNDERGROUND UTILITIES IN THE AREA CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

EA ENGINEERING ASSOCIATES
TX REG #F-4925
Ph: 903 . 473 . 1977
4189 FM 2946 . Emory, TX 75440

No.	REVISIONS	DATE	BY

Kimley»Horn
© 2025 KIMLEY-HORN AND ASSOCIATES, INC.
260 EAST DAVIS STREET, SUITE 100 MCKINNEY, TX 75069
PHONE: 469-301-2580
WWW.KIMLEY-HORN.COM TX F-928

JIM D. DALLAS
85922
LICENSED PROFESSIONAL ENGINEER
07/07/2026

KHA PROJECT	068925104
DATE	JULY 07, 2026
SCALE	AS SHOWN
DESIGNED BY	JW
DRAWN BY	CAD
CHECKED BY	JW

HOLIDAY REC AREA
RESTROOM UTILITY
IMPROVEMENTS
PREPARED FOR
SABINE RIVER AUTHORITY

ELECTRICAL
SPECIFICATIONS

SHEET NUMBER
E3.00